


Service Above Roof

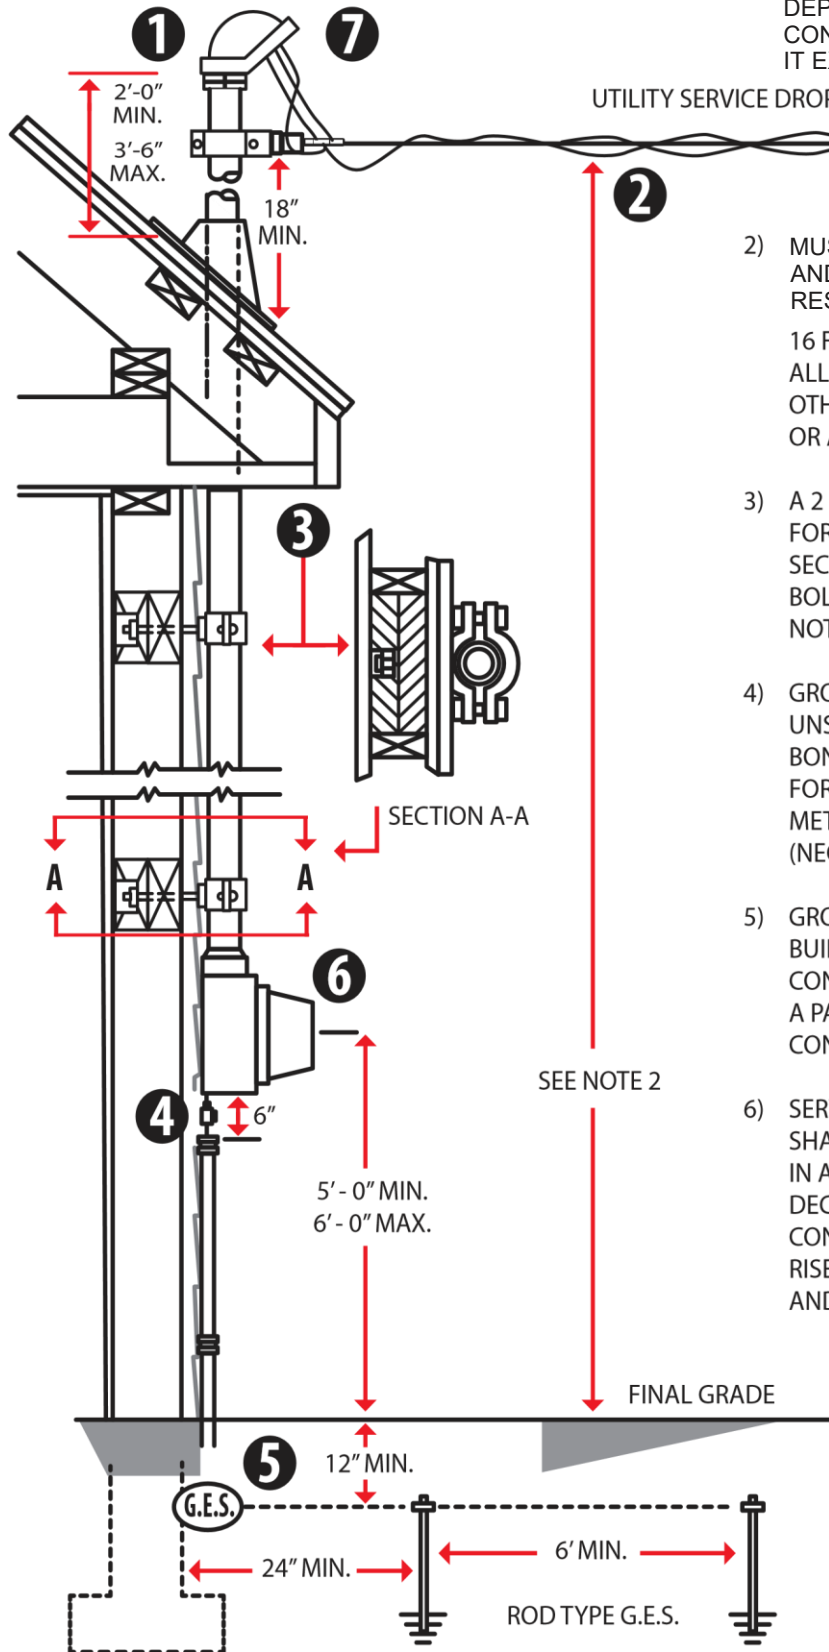

- 1) TO MAINTAIN 12-FT. CLEARANCE FROM FINISHED GRADE TO ATTACHMENT POINT. VERITICAL CLEARANCE OF CONDUCTOR TO ROOF SURFACE DEPENDS ON THE SLOPE OF THE ROOF. CONDUIT SHALL BE GUYED OR BRACED SHOULD IT EXCEED THE 3'-6" MAX. (SEE NEC 230-24 (A))
- 2) MUST MAINTAIN 12' MIN. FOR SPACES AND WAYS SUBJECT TO PEDESTRIAN OR RESTRICTED TRAFFIC AND 16 FT. MINIMUM ABOVE DRIVEWAYS, PARKING LOTS, ALLEYS, CULTIVATED OR GRAZING AREAS, LAWNS, OR OTHER LAND THAT COULD BE TRAVERSED BY VEHICLES OR ANIMALS WITH RIDERS
- 3) A 2 1/2 INCH OR LARGER (CONTACT INTER-COUNTY ENERGY FOR MIN. SIZE REQUIRED) RIGID STEEL CONDUIT TO BE SECURED WITH TWO OR MORE, THROUGH-THE-WALL BOLTS AND APPROVED MAST CLAMPS (BOLTS SHALL NOT BE LOCATED INSIDE PANELBOARD)
- 4) GROUNDING ELECTRODE CONDUCTORS SHALL BE UNSPLICED AND HAVE 6" EXPOSED FOR THE INTERSYSTEM BONDING TERMINAL (4 POSITION BLOCK TERMINAL MIN. FOR OTHER SYSTEMS) ELECTRICAL NON-METALLIC OR METALLIC CONDUIT SHALL BE USED FOR PROTECTION (NEC 250.64E)
- 5) GROUNDING ELECTRODE SYSTEM (G.E.S.) ALL NEW BUILDING FOUNDATIONS CONTAINING QUALIFIED CONCRETE-ENCASED REINFORCING RODS, MUST BECOME A PART OF THE G.E.S. ALL OTHER INSTALLATIONS MUST CONSIDER PIPE, ROD OR PLATE TYPE G.E.S.
- 6) SERVICE DROP CONDUCTORS, INCLUDING DRIP LOOPS SHALL HAVE A CLEARANCE OF NOT LESS THAN 3 FT. IN ANY DIRECTION FROM WINDOWS, DOORS, PORCHES, DECKS, FIRE ESCAPES OR SIMILAIR LOCATIONS. CONTACT INTER COUNTY ENERGY FOR METERBASE AND RISER/WEATHERHEAD LOCATION, BY-PASS REQUIREMENTS, AND POINT OF ATTACHMENT.
- 7) LEAVE MIN. 18 INCHES OF WIRE EXTENDED OUT OF WEATHERHEAD FOR DRIPLOOP.

LOCATION OF METERBASE SHALL BE DETERMINED AND FLAGGED BY INTER COUNTY ENERGY ENGINEER

INTER COUNTY
ENERGY COOPERATIVE

A Touchstone Energy Cooperative