


Underground Service

- 1) INTER-COUNTY ENERGY TO APPROVE METER BASE LOCATION.
- 2) SERVICE NEUTRAL, METER BASE MUST BE PERMANENTLY GROUNDED IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE.
- 3) CONDUIT TO BE FURNISHED AND INSTALLED BY MEMBER, INCLUDING A CONDUIT PULL ROPE.
- 4) METER BASE TO BE OBTAINED, INSTALLED AND ADEQUATELY SECURED BY MEMBER. 200 AMP OR LARGER URD METER BASE REQUIRED.
- 5) CHANGES IN CONDUIT DIRECTION: MAXIMUM OF 2- 90° 36" SCH. 40 PVC SWEEP ELBOWS OR ANGULAR EQUIVALENT.
- 6) TRENCH TO BE LEFT OPEN ON EACH END AND AT 2 INTERMEDIATE POINTS ALONG ROUTE FOR INSPECTION.
- 7) CONTACT INTER-COUNTY ENERGY TO HELP INSTALL ELBOW IN EXISTING TRANSFORMER VAULT.
- 8) IF RUNNING FROM POLE: MEMBER MUST SUPPLY 10 FT. SCH 80 PVC CONDUIT AND 30 FT. SCH 40 PVC CONDUIT FOR INTER-COUNTY ENERGY TO RUN UP POLE.

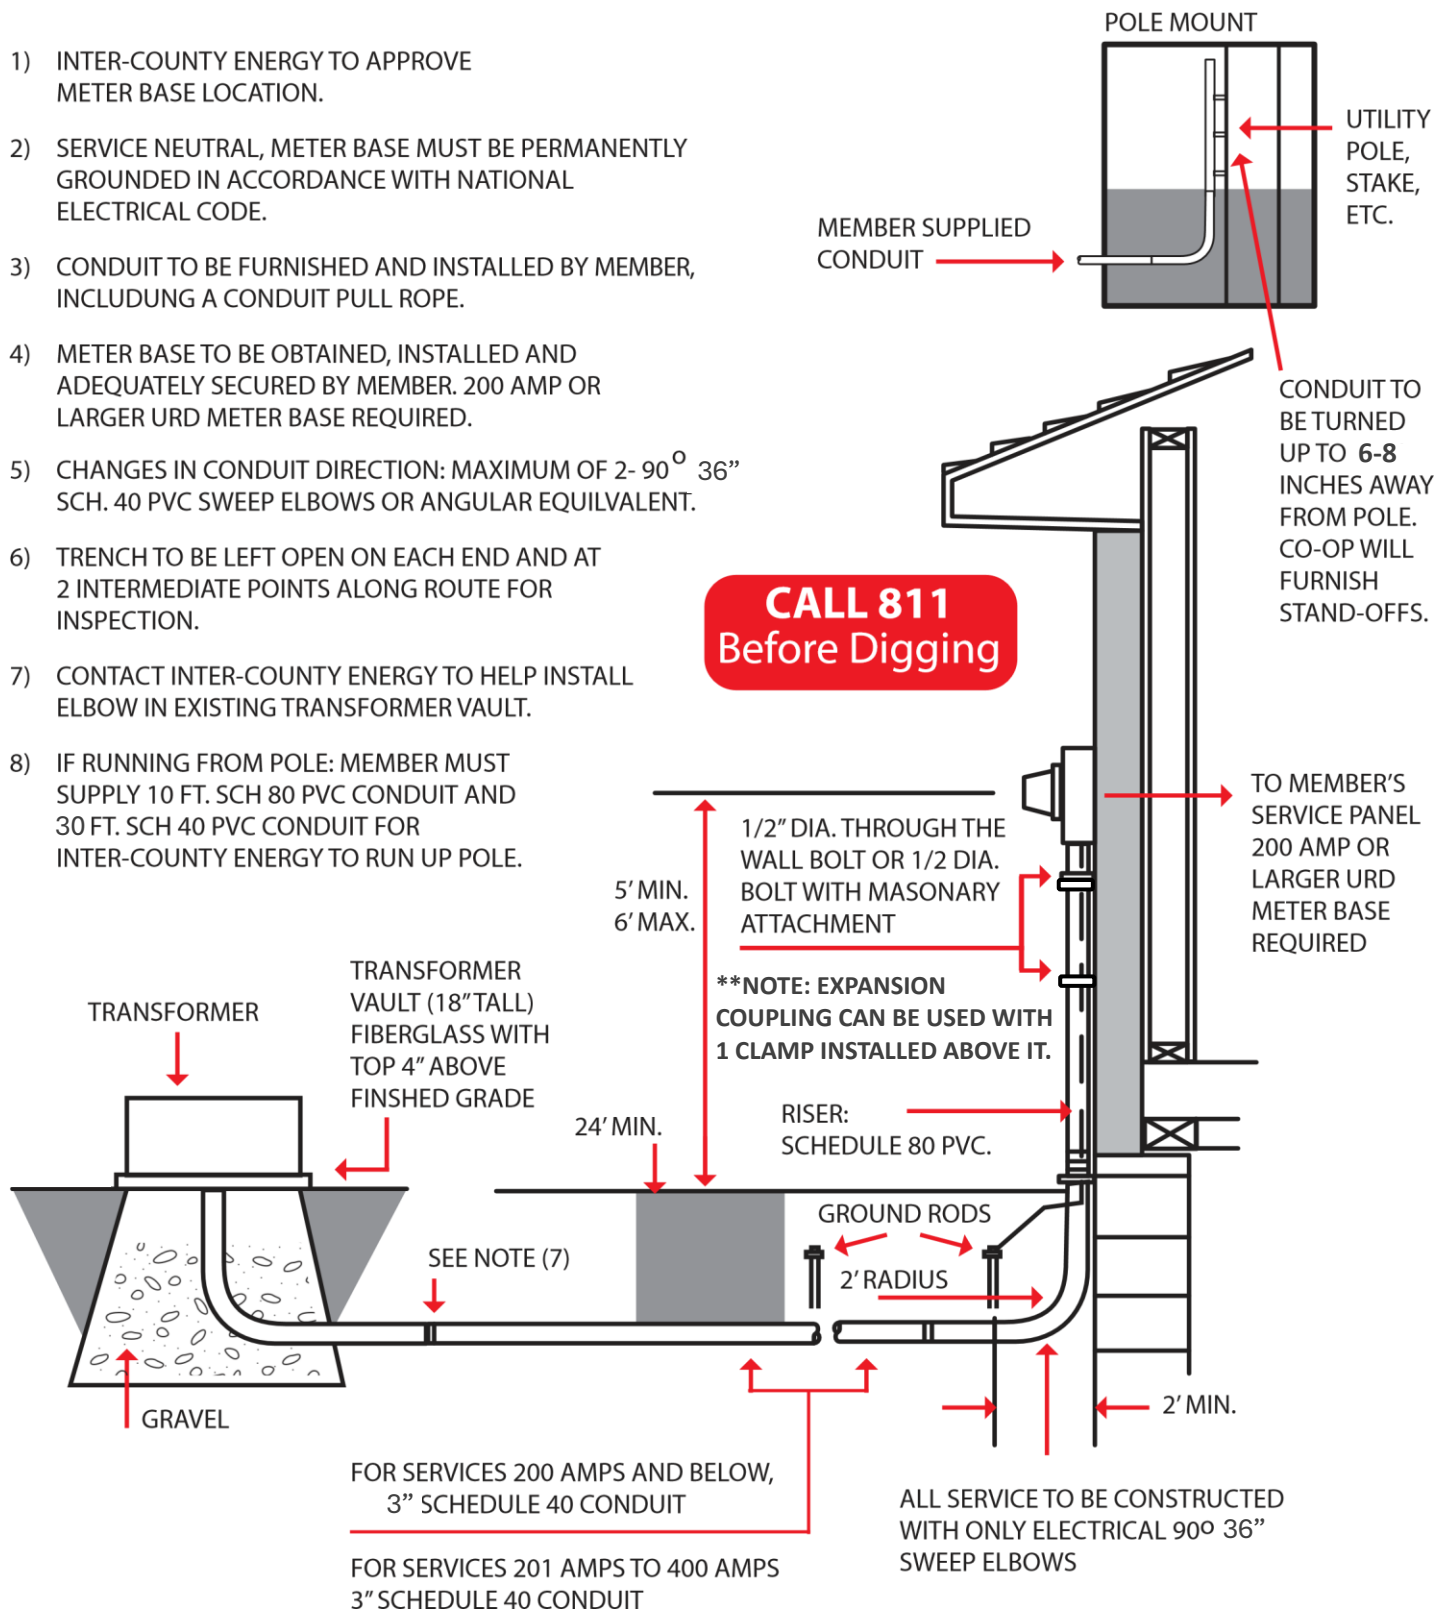

IMPORTANT: SHOULD TRENCH LENGTH EXCEED 100' OR SERVICE ENTRANCE SIZE BE LARGER THAN 400 AMP, CONSULT INTER-COUNTY ENERGY FOR SPECIAL DESIGN.

**LOCATION OF METERBASE MUST BE DETERMINED AND FLAGGED BY
INTER-COUNTY ENERGY ENGINEER**