Temporary Meter Pole Service

Direct Wire Type to Service Pole

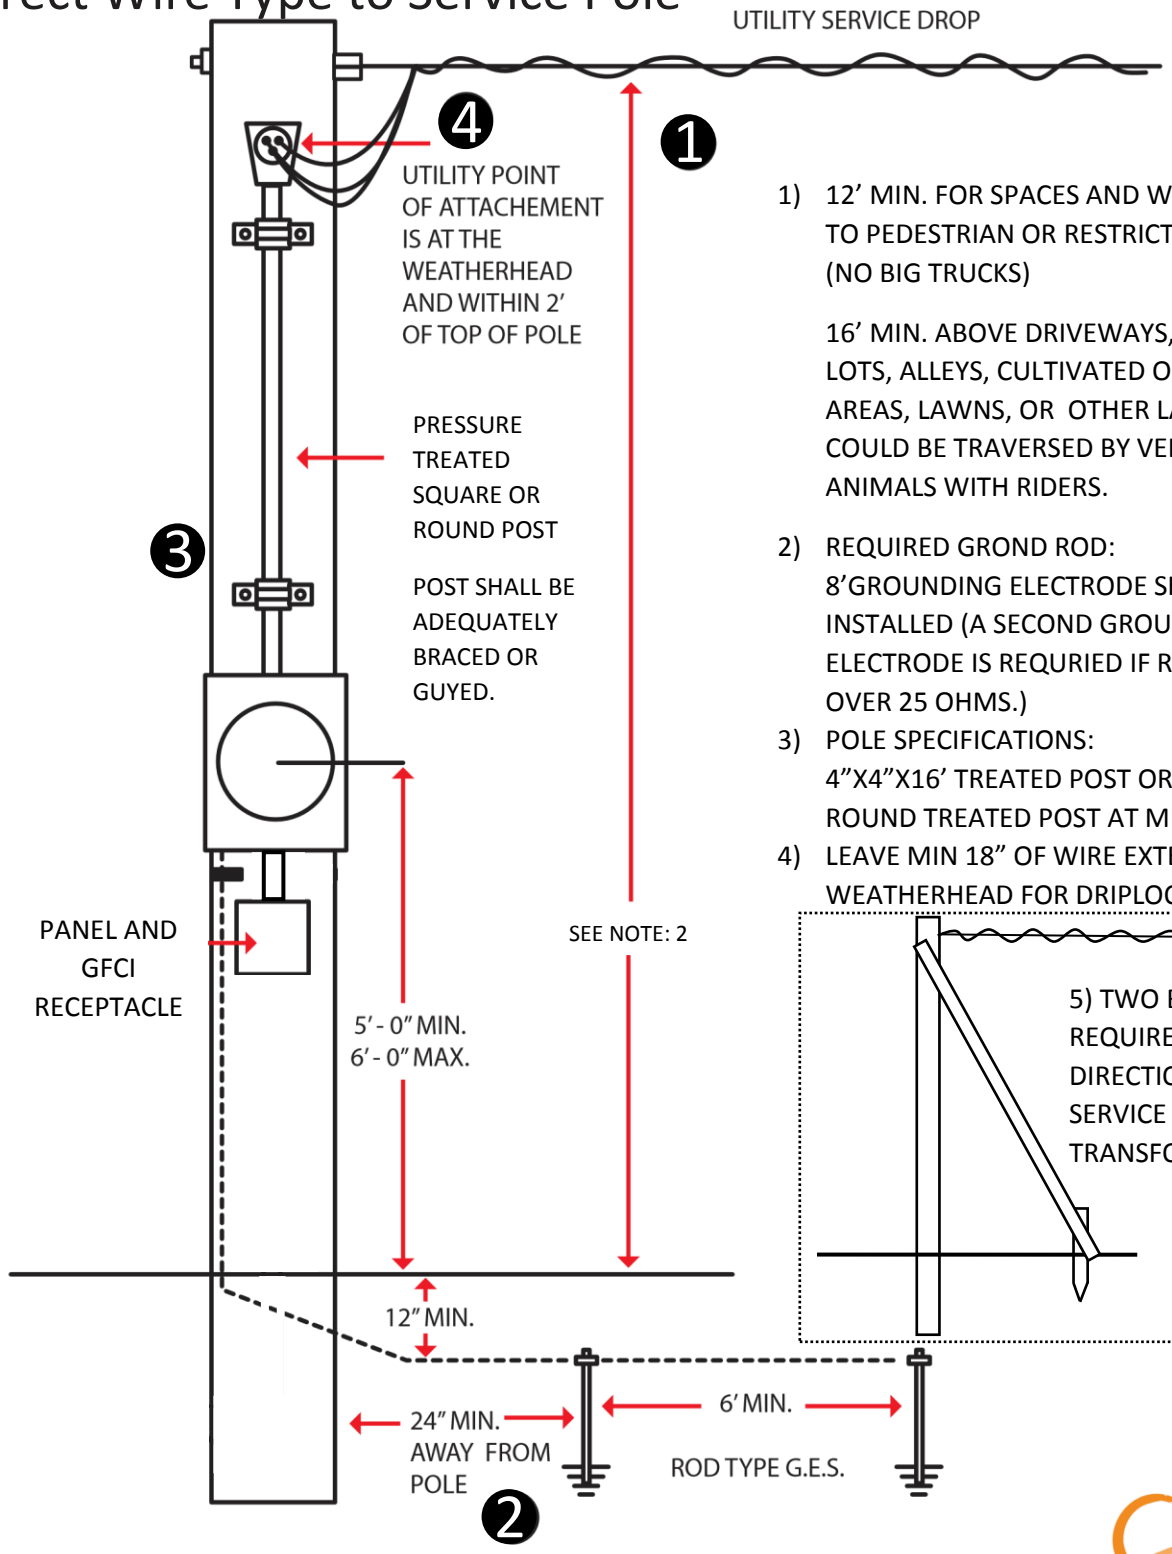

1) 12' MIN. FOR SPACES AND WAYS SUBJECT TO PEDESTRIAN OR RESTRICTED TRAFFIC. (NO BIG TRUCKS)

   16' MIN. ABOVE DRIVEWAYS, PARKING LOTS, ALLEYS, CULTIVATED OR GRAZING AREAS, LAWNS, OR OTHER LAND THAT COULD BE TRAVERSED BY VEHICLES OR ANIMALS WITH RIDERS.

2) REQUIRED GROND ROD: 8'GROUNDING ELECTRODE SHALL BE INSTALLED (A SECOND GROUNDING ELECTRODE IS REQURIED IF RESISTANCE IS OVER 25 OHMS.)
3) POLE SPECIFICATIONS: 4"X4"X16' TREATED POST OR 6"X16' ROUND TREATED POST AT MINIMUM.
4) LEAVE MIN 18" OF WIRE EXTENDED OUT OF WEATHERHEAD FOR DRIPLOOP.

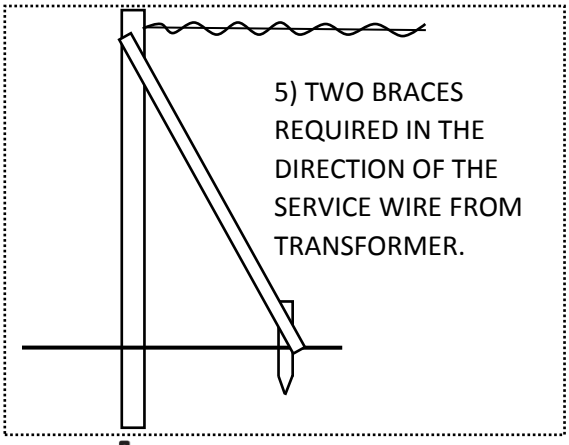

INTER COUNTY ENERGY COOPERATIVE

A Touchstone Energy® Cooperative